


CASE STUDY: - ICICI BANK, MUMBAI....

Re-known bank in Private sector. We had installed 25 Kva Powerwin™- Power Saver in this bank for Live demo.

In ICICI Bank, we have received 21% saving in Energy/Power. We have noted 10-days data before and after installation of Powerwin™-Power Saver.

Pl see graphical comparison for Power consumption before and after installation of Powerwin™-Power Saver for **Mix (Lighting plus Air-conditioner plus computers plus server)** type of load.

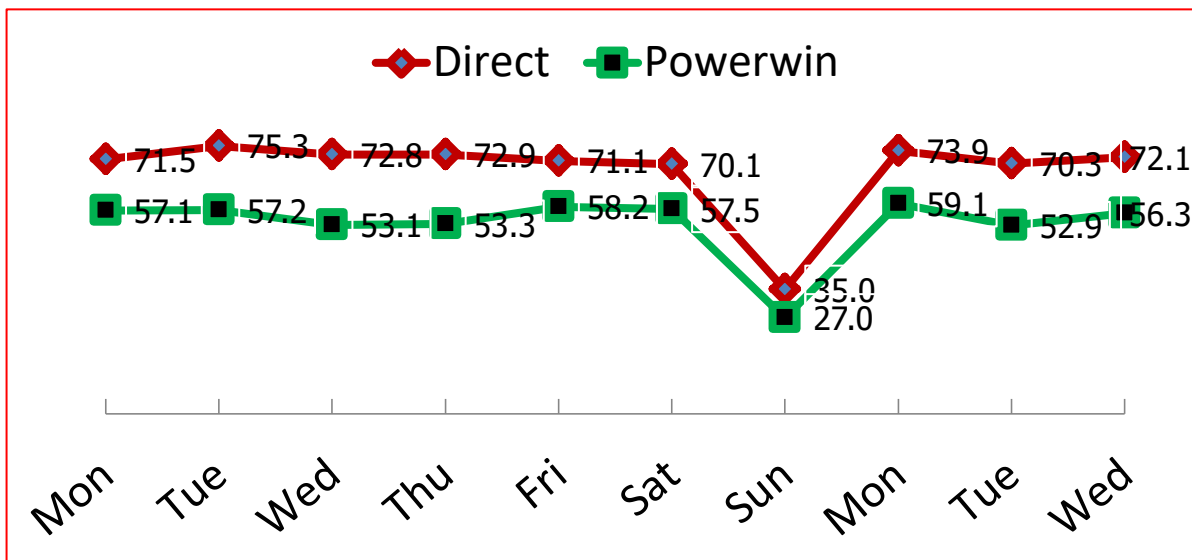

%Saving Calculations:

Total Avg. Unit consumption in Direct Mode : 72.00

Total Avg. Unit consumption in Powerwin Mode : 57.10

Difference: 15.27

$$\begin{aligned}\% \text{ Energy Saving} &= \frac{(\text{Direct Consumption} - \text{Saving Consumption}) \times 100}{\text{Direct Consumption}} \\ &= \frac{(72.0 - 57.1) \times 100}{72.0} \\ &= \mathbf{21\%}\end{aligned}$$